



BRUHAT BENGALURU MAHANAGARA PALIKE
Medical Officer of Health, Byatarayanapura, Yelahanka Zone, Bangalore-92

NO: BBMP/YZ/MOH(BTP)/PR/99 /23-24

Date:22.05.2023


CONTENT OF THE SEAL TRANSLATED FROM KANNADA TO ENGLISH

SAFE DRINKING WATER AND SANITARY CONDITION
CERTIFICATE

It is certifies that an inspection team headed by Medical Officer of Health- BBMP inspected the "PKS EDUCATION TRUST", Arkavathi Layout, Sampigehalli, Jakkur Post, Bangalore-560064, on 15.05.2023 and found that "PKS EDUCATION TRUST" has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building and the campus as per the norms prescribed by the State Government.


The above is valid for a period of - 1 year

Medical Officer of Health.
Yelahanka Zone.
Bruhat Bengaluru Mahanagara Palike
Bangalore.


Medical Officer of Health,
Byatarayanapura Division
Yelahanka Zone
BBMP, Bangalore-92
ಬಿ.ಬಿ.ಎಂ.ಪಿ., ಬೆಂಗಳೂರು-92
ಬಿ.ಬಿ.ಎಂ.ಪಿ.

To,
The Managing trustee
"PKS EDUCATION TRUST",
Arkavathi Layout, Sampigehalli,
Jakkur Post, Bangalore-560064

Translated by Me.

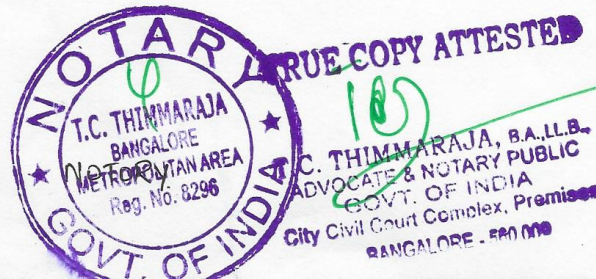



CHARITON RESEARCH INSTITUTE PRIVATE LIMITED

No.67/3, 1st Floor, Industrial Suburb, Yeshwanthpur, BANGALORE - 560 022. INDIA

TEST CERTIFICATE

DRINKING WATER TEST REPORT

FORMAT NO: CRI/7.8/F/01

Name & Address of the Customer	M/s. PKS School Block-2, Arkavathy layout, Sampigehalli, Jakkur, bangalore-560064	Sample No: 133/ENV/05/2023
		Group: Water
		Product: Drinking water
		Sample type: Drinking Water
Date of sample Collection	24.05.2023	Date of Report: 24.05.2023
Date of Sample Receipt	24.05.2023	Sample Location: -----
Duration of Test	24.05.2023	Sample Condition: Good
Sampling Done by	CRI Representative	Env. Condition: Temp. 25°C & RH: 56%
Sampling Method: IS 3025 Part 1		

Sl. No.	Parameters	Units	Results	Limits as per IS 10500:2012		Test method
				Acceptable Limits	Permissible Limits	
1.	pH @ 25°C	---	7.06	6.5 - 8.5	No Relaxation	IS:3025(Part-11)
2.	Odour	--	Agreeable	Agreeable	Agreeable	IS 3025 (Part-5)
3.	Colour	Hazen	2.0	5	15	IS:3025(Part-4)
4.	Total Dissolved solids	mg/l	44	500	2000	IS:3025(Part-16)
5.	Turbidity	NTU	<1.0	1	5	IS:3025(Part-10)
6.	Conductivity @ 25°C	µS/cm	66	Not Specified	Not Specified	IS:3025(Part-14)
7.	Alkalinity as CaCO ₃	mg/l	32	200	600	IS:3025(Part-23)
8.	Hardness as CaCO ₃	mg/l	28	200	600	5 of IS:3025(Part-21)
9.	Calcium as Ca	mg/l	6.4	75	200	5 of IS:3025(Part-40)
10.	Magnesium as Mg	mg/l	2.9	30	100	6 of IS:3025(Part-46)
11.	Chloride as Cl	mg/l	12.0	250	1000	2 of IS:3025(Part-32)
12.	Sulphate as SO ₄	mg/l	1.8	200	400	4 of IS:3025(Part-24)
13.	Iron as Fe	mg/l	<0.01	1.0	No Relaxation	7 of IS-3025 (Part-53)
14.	Fluoride as F	mg/l	<0.01	1	1.5	APHA 23 rd Edition 4500F D
15.	Nitrate as NO ₃	mg/l	<0.01	45	0.05	3 of IS:3025(Part-34)
16.	Ammonia as NH ₃	mg/l	<0.01	0.5	No Relaxation	2.3 of IS:3025(Part-34)
17.	Boron as B	mg/l	<0.01	0.5	1.0	6 of IS 3025(Part-57)

y.p.shetty
Secretary
P.K.S. SCHOOL
Arkavathy Layout, Sampigehalli
Jakkur, Bengaluru - 560 064

Bharathi Shetty
PRINCIPAL
P.K.S. SCHOOL
Arkavathy Layout, Sampigehalli
Jakkur, Bengaluru - 560 064

Dr Kumar A 24/05/2023
Authorized Signatory
Dr Kumar A
Technical Manager

